




CITY OF NITRO
2009 20th St.
NITRO, WV 25143
Phone: (304) 755-0702


NITRO REGIONAL WASTEWATER UTILITY
RESIDENTIAL SINGLE UNIT SEWER CONNECTION INFORMATION

1. Each property owner must make application to the Nitro Regional Wastewater Utility for a sewer connection.
2. A sewer-tap and four (4") inch lateral line will be laid to the one property line.
3. The West Virginia Public Service Commission (PSC) has approved a rate schedule for sewer service including a sewer connection fee. The PSC Order is on file at the Sanitary Board Office.
4. The rate schedule provides for payment of Sewer Connection Fee under two conditions:
 - a. Service Connection Inspection Fee - \$25.50 – (plus 2% tax) To apply where service connection is in place ready for the owner to connect, generally at the property line.
 - b. Service Connection Fee - \$408.00 – (Plus 2% tax) To apply where an opening must be made by the Sanitary Board in said Sanitary Board's collector sewer, and service line laid from such opening (tap) to owner's property line.
5. Sewer Connection Inspection Fees are payable before tap permit will be issued and/or inspection made.
6. It is the responsibility of the property owner to install the service line from the property line connection to the building.
7. It is required that the property owner use a minimum of four (4) inch plastic (schedule 35 or 40) pipe with "O" – ring type gaskets. Schedule 40 PVC is acceptable with glue connections. However, gasket type PVC pipe is preferable. The sewer pipe would should be laid with a minimum slope of 1/8 inch per foot (6" in 50 foot of pipe) from property line connection to the building. Commercial buildings or multiple unit building size of line will depend on flow capacity needed. This will be determined at time application for tap is made.
8. A "wye" connection (clean-out) is to be installed within three (3) feet of the house service connection (near the property line) to tap lateral, with clean-out toward tap at main line connection. Clean-out must have plug.
9. It is required that another clean-out be installed outside the building within three (3') feet.
10. INFORMATION: If you have any questions regarding the construction program or sewer connections, please contact the Nitro Regional Wastewater Utility at (304) 755-3669.

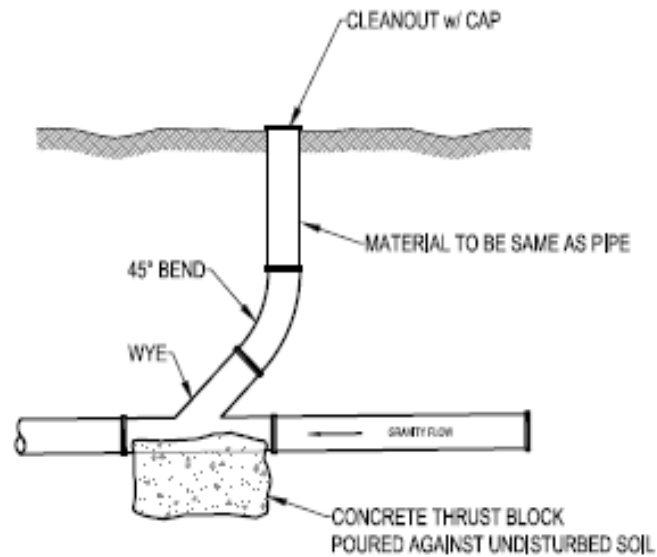

TYPICAL GRAVITY CLEANOUT

NOT TO SCALE

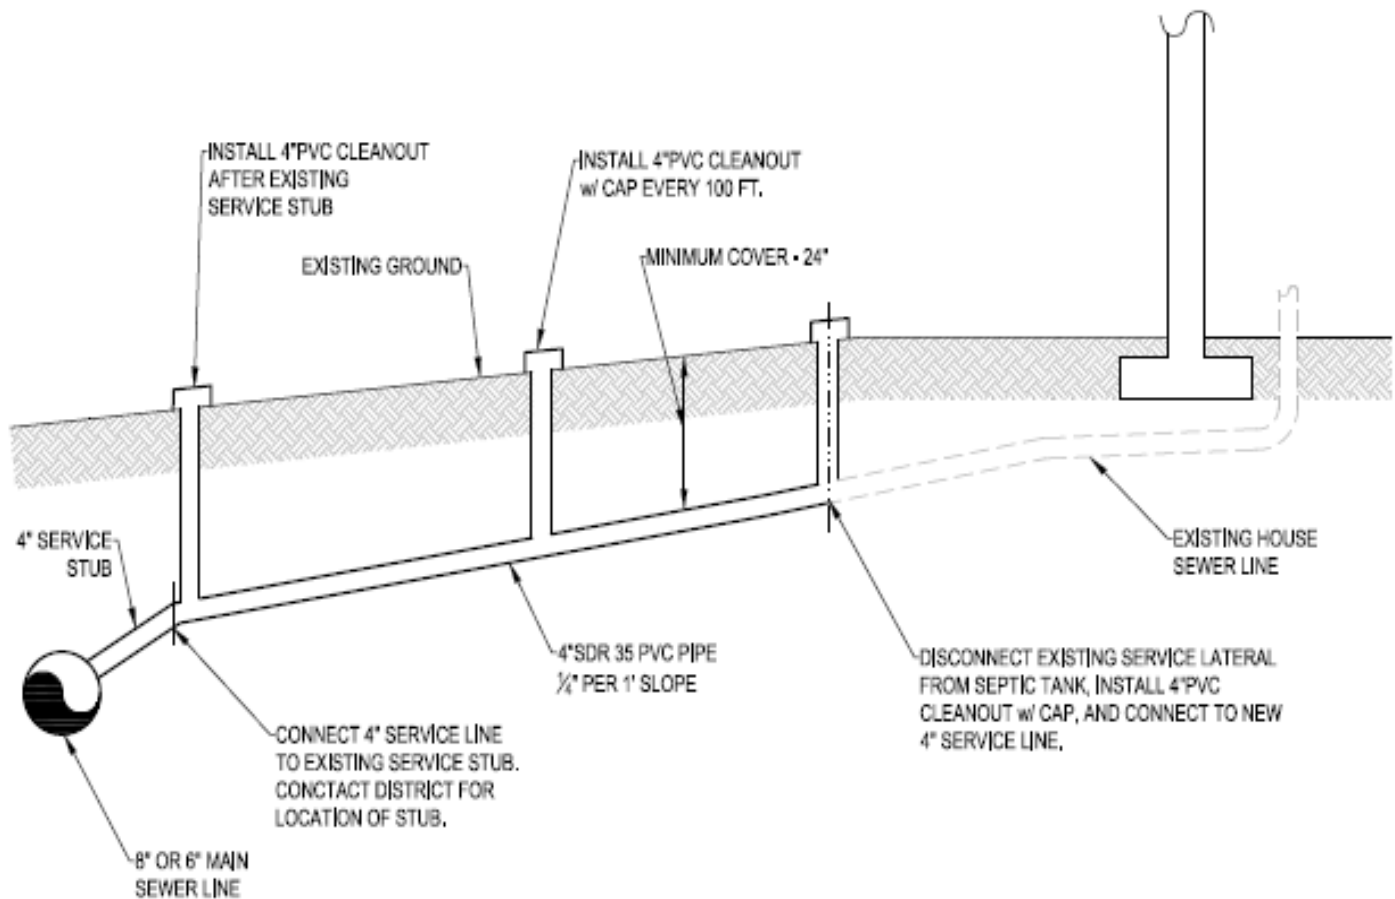

TYPICAL HOUSE SERVICE CONNECTION

NOT TO SCALE